

# Solve the timing challenges of 5G



# Supporting your changing environment

As the world prepares for 5G, the levels of synchronization accuracy and speed of data transfer required are increasing exponentially. In response, the ITU-T is enhancing the G.827x series of standards to cover next-generation accuracy requirements – to ensure that Ethernet systems are robust against varying transmission delays and other effects that can significantly disrupt the precise transfer of timing. These ITU-T standards also form the foundation of timing requirements for new Open Radio Access Networks, and are inherently required for O-RAN compliance.

The Paragon-neo is the latest platform from Calnex, providing PTP and SyncE testing of speeds up to 100GbE. It's designed to meet the stringent test requirements of NEMs who are developing, verifying and manufacturing devices against enhanced timing standards such

as for ITU-T G.8273.2 Class-C/D Boundary Clocks, O-RAN compliant O-DU and O-RU equipment, and for those designing and deploying 5G networks and systems.


What's more, because high network efficiency and reduced data transmission costs are only possible with highly accurate timing, Paragon-neo offers hardware performance and software test methodologies allowing *sub-nanosecond accuracy* for the entire test system.

To meet the timing challenges of 5G deployments, Calnex is committed to providing the most advanced, precise and reliable test solutions to make sure your devices and systems deliver the high quality network services of the future. In a changing world, it's good to know that some things never change.

Analyse PTP conformance to standards-based or user-defined profiles, with automatic indication of pass/fail (and reason for non-compliance) and report generation.

Generate SyncE wander and jitter for ITU-T G.8262.1/G.8262 testing, simultaneously measure SyncE wander and PTP Time Error, and control ESMC message generation for testing to ITU-T G.8264.

Emulate PTP clocks to maximise accuracy and repeatability of PTP test, including specific test modes for various DUTs and automatic test selection for ITU-T and O-RAN standards conformance.

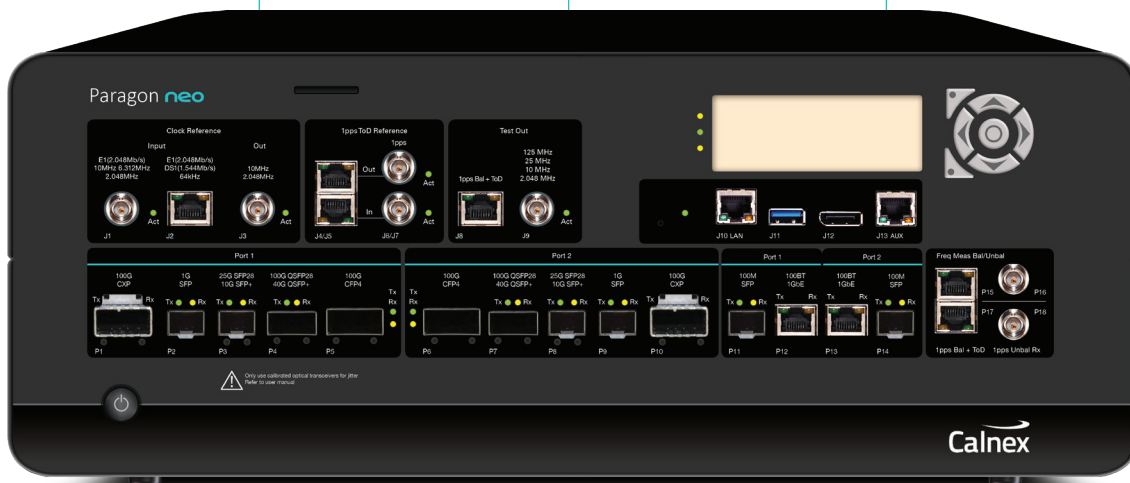

## PTP Field Verifier (PFV)

- Analyse PTP protocol for conformance to standards or user-defined profiles.
- Automatic pass/fail indication – check captured PTP messages against a pre-defined set of rules, with clear pass/fail alerts.

Direction	Packet #	Arrival Time	messageType	reservedField2	sourcePortIdentity	sequenceId	logMessageInterval (s)	PTP Fields
0	0	0.000000000	SYNC	0x0	0x4f4c2f0000000000	19826	-4	origTimestamp-2013 312 22 06 21 27 45503
1	1	0.00374565	DEL_REQ	0x0	0x0000000000000000	38231	127	origTimestamp-2013 312 06 21 27 45503
2	2	0.00581885	DEL_RESP	0x0	0x4f4c2f0000000000	38231	-4	recvTimestamp-2013 312 06 21 27 45578
3	3	0.03301940	SYNC	0x0	0x4f4c2f0000000000	19827	-4	origTimestamp-2013 312 22 06 21 43303
4	4	0.05597000	SYNC	0x0	0x4f4c2f0000000000	19828	-4	origTimestamp-2013 312 06 21 27 45503
5	5	0.06874585	DEL_REQ	0x0	0x0000000000000000	38232	127	recvTimestamp-2013 312 06 21 27 45578
6	6	0.06936970	DEL_RESP	0x0	0x4f4c2f0000000000	38232	-4	origTimestamp-2013 312 22 06 21 43303
7	7	0.06002580	SYNC	0x0	0x4f4c2f0000000000	19829	-4	origTimestamp-2013 312 06 21 27 45503
8	8	0.12024645	SYNC	0x0	0x4f4c2f0000000000	19830	-4	recvTimestamp-2013 312 06 21 27 45578
9	9	0.13137455	DEL_REQ	0x0	0x0000000000000000	38233	127	origTimestamp-2013 312 22 06 21 43303
10	10	0.13184375	DEL_RESP	0x0	0x4f4c2f0000000000	19831	-4	origTimestamp-2013 312 06 21 27 45503
11	11	0.15011205	SYNC	0x0	0x4f4c2f0000000000	19832	-4	recvTimestamp-2013 312 06 21 27 45578
12	12	0.16024560	SYNC	0x0	0x4f4c2f0000000000	19834	-4	origTimestamp-2013 312 22 06 21 43303
13	13	0.16387455	DEL_REQ	0x0	0x0000000000000000	38235	127	origTimestamp-2013 312 06 21 27 45503
14	14	0.19443055	DEL_RESP	0x0	0x4f4c2f0000000000	19833	-4	recvTimestamp-2013 312 06 21 27 45578
15	15	0.21004020	SYNC	0x0	0x4f4c2f0000000000	19834	-4	origTimestamp-2013 312 22 06 21 43303
16	16	0.24002160	SYNC	0x0	0x4f4c2f0000000000	19835	-4	origTimestamp-2013 312 06 21 27 45503
17	17	0.25637455	DEL_REQ	0x0	0x0000000000000000	38236	127	recvTimestamp-2013 312 06 21 27 45578
18	18	0.25691005	DEL_RESP	0x0	0x4f4c2f0000000000	19836	-4	origTimestamp-2013 312 22 06 21 43303
19	19	0.27000055	SYNC	0x0	0x4f4c2f0000000000	19837	-4	origTimestamp-2013 312 06 21 27 45503
20	20	0.30060725	SYNC	0x0	0x4f4c2f0000000000	38237	-4	recvTimestamp-2013 312 06 21 27 45578
21	21	0.31807455	DEL_REQ	0x0	0x0000000000000000	19838	127	origTimestamp-2013 312 22 06 21 43303


  

Average Message Rate (msg/sec)				Total Counts	
SYNC	23.73	FOLLOW-UP	0.00	ANNOUNCE	0.00
DEL-REQ	15.93	DEL-RESP	10.20	SIGNALING	1.35
				Packets	302
				Error Packets	10

**FAIL**  
Total Pass Rate: 96.66%

## Conformance Test Application

- Start testing in seconds – just two clicks to configure crucial standards-defined test sequences.
- Automatically generates PTP and ESMC messages, Time Error and SyncE impairments, and applies filters, metrics and masks.

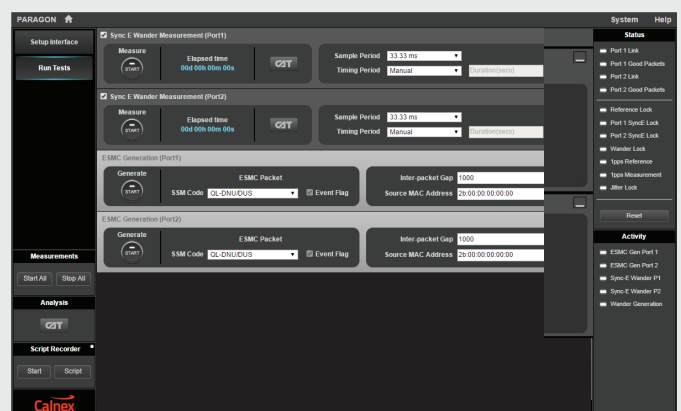




- Analyze the Time Error (TE) of, for example, Class-C/D T-Boundary Clocks or Class-B PRTC/Master Clocks.
- Apply standards-defined Time Error impairments.
- Combine with SyncE and ESMC for complex tests such as Phase Noise Response to SyncE Transient.

## PTP Applications

Test hybrid devices simultaneously with PTP Time Error/ SyncE wander and measure output packet timing, recovered clocks and SyncE wander with unbeatable test accuracy and repeatability.

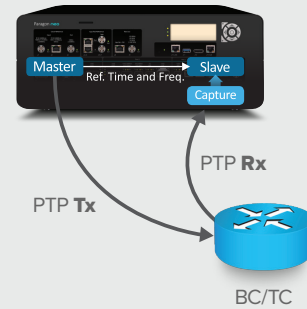


### Application

Boundary Clock Testing
Transparent Clock Testing
Assisted Partial Timing Support Clock Testing
Master Clock Testing
O-DU and O-RU Testing

### Standard


ITU-T G.8273.2
ITU-T G.8273.2
ITU-T G.8273.4
ITU-T G.8272
O-RAN.WG4.CUS.0

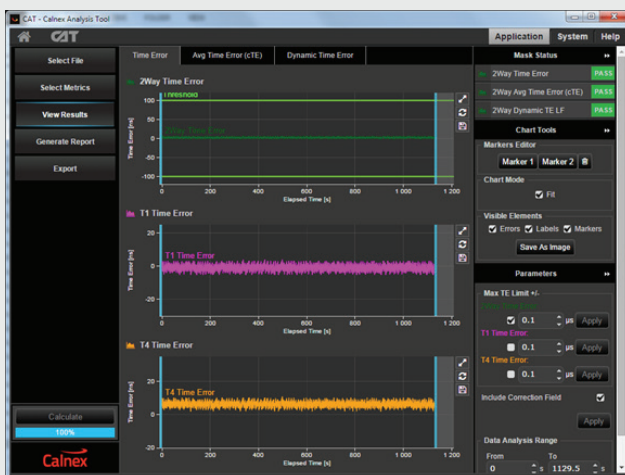

The Calnex Analysis Tool (CAT) provides powerful insight into network and device performance. All your measurement results are now in one place, and you can view multiple graphs simultaneously for easier correlation of your results. Plus, with enhanced graphics, it's easy to evaluate metrics such as MTIE and TDEV against ITU-T and O-RAN masks.

## SyncE Applications – ITU-T G.8262.1/G.8262 (Jitter and Wander)

The Paragon-neo supports full SyncE testing up to 100GbE to ITU-T G.8262.1/G.8262 including Wander Tolerance, Wander Transfer, Wander (Noise) generation, Pull-in, Hold-in and Pull-out ranges, Frequency Accuracy and Phase Transient, plus Jitter Tolerance and Jitter Generation.

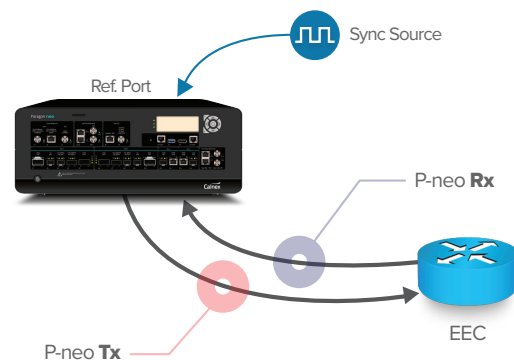

### Application

SyncE Jitter Generation
SyncE Jitter Tolerance
SyncE Wander (noise) Generation
SyncE Wander (noise) Tolerance
SyncE Wander (noise) Transfer
SyncE Short Term Phase Transient

### P-neo Tx

Jitter free
Apply Jitter
Wander free
Apply Wander
Apply Wander
Break line or set ESMC QL=DNU

### P-neo Rx

Measure Jitter
Check Test Packets
Measure Wander
Check ESMC
Measure Wander
SyncE TIE, MTIE

## PTP Performance Summary

- Capture and decode PTP packets for analysis and Time Error testing.
- PTP clock emulation, plus the Paragon-neo's unique conformance test application, removes uncertainty and maximizes test repeatability – essential for validating new, high-accuracy 5G network devices.
- Automatic test of PTP profile compliance for simple and reliable verification against standards-based or user-defined profile configurations.

## SyncE Performance Summary

- Prove SyncE wander performance to ITU-T G.8262.1/G.8262.
- Evaluate MTIE/TDEV pass/fail results to ITU-T G.8262.1/G.8262 masks.
- Check ESMC (SSM) messaging to ITU-T G.8264.
- Test SyncE jitter performance to ITU-T G.8262.1/G.8262.

## Specifications

Product	
Optical Interfaces (all optional)	1GbE: SFP 10GbE: SFP+  100M: SFP 25GbE: SFP28 40GbE: QSFP+ 100GbE: QSFP28
Electrical Interfaces	1000/100 BASE-T: RJ45
External Reference Clocks	Lock internal timing reference to external reference. External reference inputs: 64 kHz, 2.048 MHz, 10 MHz, T1 BITS clock (1.544 Mb/s), E1 MTS (2.048 Mb/s).
Internal Reference Clock	Frequency stability over temperature – better than $\pm 1 \times 10^{-9}$ . Short term phase stability – better than 500 ps. Rb Option – for future upgrades (optional).
Clock Reference Output Ports	2 x 10 MHz/2.048 MHz Reference Outputs (BNC).
Phase Measurement	1 pps – BNC (unbalanced). 1 pps – RJ (balanced).
1 pps + ToD Reference Input	1 pps Unbalanced Input (BNC), 1 pps Balanced Input + ToD (RJ48C). ToD format: CCSA, ITU-T, NMEA.
1 pps + ToD Reference Output	1 pps Unbalanced Output (BNC), 1 pps Balanced Output + ToD (RJ48C). ToD format: CCSA, ITU-T, NMEA.
PTP	
Standards	IEEE 1588-2008 G.8273.2 including Class-C and Class-D devices. G.8272 including Class-B devices. All relevant G.826x/827x standards.
PTP Time Error Measurement Accuracy	Better than 1 ns for 1G and above Optical interfaces. Better than 5 ns for below 1G and all Electrical Interfaces*.
Master/Slave Emulation	Emulate PTP master with full parametric control. Emulate PTP slave. Add Time Error patterns e.g. G.8273.2, G.8271.1, G.8271.2, G.8261, user-defined.
Time Error Metrics	Built-in (CAT) software including industry-standard ITU-T pass/fail masks with clear pass/fail indication. Time Error (2Way and 1Way) – packet selection and filtering as per ITU-T specifications cTE, dTE, etc.
PTP Packet Analysis	Decode and display PTP Fields with PFV. (Additional options with full PFV licence: Display pass/fail to standards-based or user-defined rules; report generation capability.)
SyncE	
Jitter/Wander Measurement	ITU-T G.8262.1, G.8262 and O.174. Jitter/Wander Generation, Wander Transfer, Jitter/Wander Tolerance, Phase Transient, built-in frequency offset plus generation of sinusoidal, MTIE and TDEV Wander.
Wander Analysis	Built-in (CAT) software including industry-standard ITU-T pass/fail Masks with clear pass/fail indication. ITU-T Masks: G.8261, G.8262, G.8262.1, G.8261.1 Wander Measurements: TIE, MTIE, TDEV, clock FFO.
ESMC (SSM) Features	Decode ESMC messages to ITU-T G.8264 and graph/plot Quality Level (QL) changes graphically (bi-directional). Generate ESMC (SSM) packets as per ITU-T G.8264. Enhanced SSM fully supported.
Phase Wander Measurement Resolution	250ps
General	
PC/Mac or Tablet Control Interface	Web-based GUI with built-in controller enables use of any PC or Android Tablet with any browser with screen resolution of 1024 x 768 pixels. RJ 45 LAN connection to instrument.
Workflow	Graphical test-case driven workflow with real-time status and results. Stimulus/Response test configuration tool. Detailed configuration options also available.
Remote Control	Scripting via TCL, Perl and Python. Automatic Script Recorder for TCL, Perl and Python. Compatible with Calnex Test Sequencer (CTS) for creation/use of specific or user-defined test plans.

(\*) Future release.  
Specification is subject to change without notice.